



Option #1

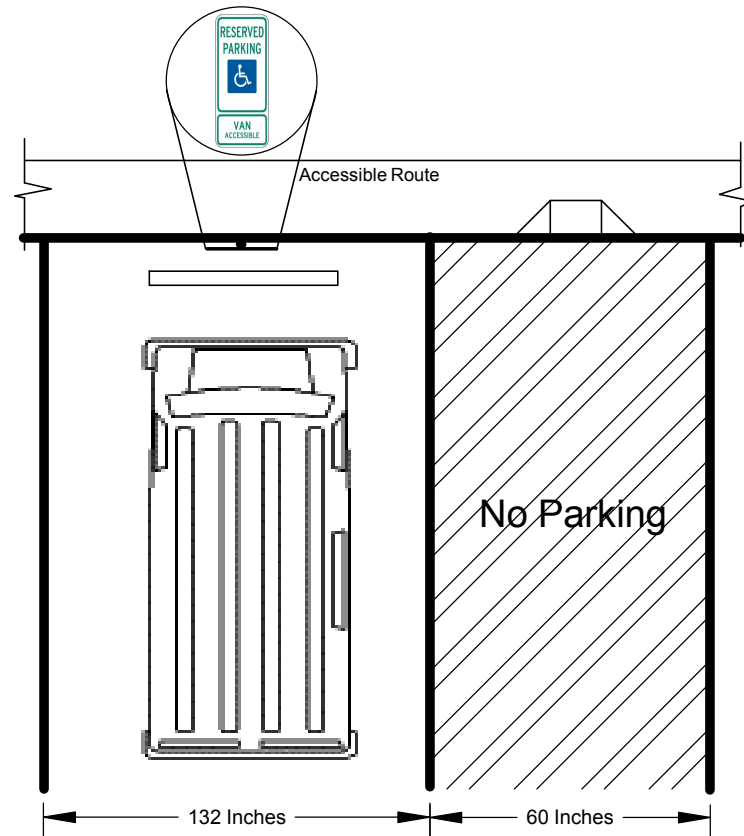

Option #2

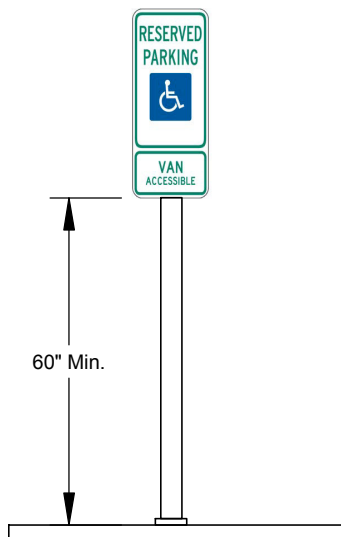

Note:

1. When only one ADA parking stall is required it shall be "Van Accessible" meeting one of the options shown.
2. ADA parking stalls shall be located as close to the main entrance of the building as possible.
3. Access aisles shall adjoin an accessible route.
4. Access aisles shall not be less than 60" in width.
5. Access aisles shall be marked to discourage parking in them.
6. Two parking stalls shall be permitted to share a common access aisle.
7. Van accessible parking shall be identified with signage designating "van accessible".



208-455-3024
Fax: 208-455-3050

*Department of
Building Safety*

TITLE
**ADA PARKING STALL REQUIREMENTS
FOR SINGLE STALL**

SIZE	CAGE CODE	DWG NO	02-15	REV
SCALE	NTS	SHEET	1	